


FINAL

Withlacoochee Regional Water Supply Authority

Phase II - Detailed Water Supply Feasibility Analyses

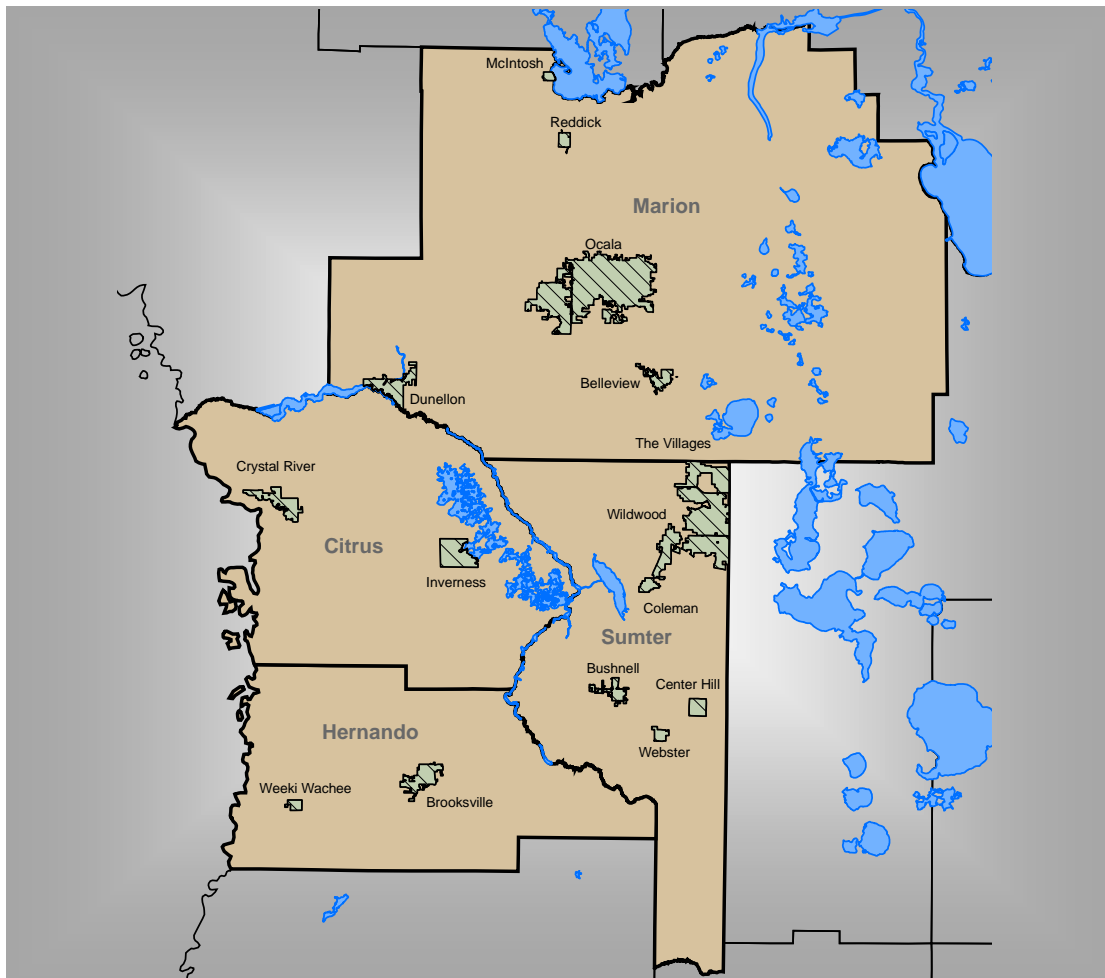

April 2010

Prepared for



**WITHLACOOCHEE
REGIONAL
WATER
SUPPLY
AUTHORITY**

Prepared by



ACKNOWLEDGEMENTS

Members of the WRWSA Board

Gary Bartell, Commissioner, Citrus County
Dennis Damato, Commissioner, Citrus County
Winn Webb, Commissioner, Citrus County
James Adkins, Commissioner, Hernando County
John Druzbeck, Commissioner, Hernando County
Jeff Stabins, Commissioner, Hernando County
Rose Rocco, Commissioner, Hernando County
Richard Hoffman, Representative, Sumter County
Randy Mask, Commissioner, Sumter County
Dale Swain, Representative, City of Bushnell
Ken Hinkle, City Councilman, City of Inverness
Joe Bernardini, City Councilman, City of Brooksville
Mary Rich, City Councilwoman, City of Ocala
John Priester, City Councilman, Ocala
Christine Dobkowski, City Commissioner, City of Belleview
Mike Amsden, Commissioner, Marion County
Barbara Fitos, Commissioner, Marion County
Stan McClain, Commissioner, Marion County

WRWSA Executive Director

Jack Sullivan

Members of the WRWSA Technical Review Committee

Robert Knight, Citrus County
Kevin Smith, Citrus County
Keith Mullins, City of Crystal River
Russell Kreager, City of Inverness
Tye Chighizola, City of Ocala
Jeff Halcolmb, City of Ocala
Dale Ravencraft, Hernando County
Alys Brockway, Hernando County
Ron Pianta, Hernando County
William Gaiger, City of Brooksville
William Smith, City of Brooksville
Bradley Cornelius, Sumter County
Robert Smith, City of Wildwood
Ron Allen, Wildwood
Bruce Hickle, City of Bushnell
Larry Haag, WRWSA Attorney
Trey Arnett, The Villages
Todd Petrie, Marion County
Joe Stapf, Hernando County
John Ferguson, Southwest Florida Water Management District
David Hornsby, St. Johns River Water Management District
Andrew Houston, Crystal River
Gary Judd, Floral City
Michael Shrader, Progress Energy

Technical Contributors

Brian Armstrong, Southwest Florida Water Management District
Anthony Andrade, Southwest Florida Water Management District
Tammy Antoine, Southwest Florida Water Management District
Mark Barcelo, Southwest Florida Water Management District
Ron Basso, Southwest Florida Water Management District
Ching-tzu Huang, St. Johns River Water Management District
Diane Salz, Legislative Consultant to the WRWSA
Kathy Scott, Southwest Florida Water Management District
Carl Wright, Southwest Florida Water Management District
Terry Clark, Liaison to the St. Johns River Water Management District
Brent White, Southwest Florida Water Management District
Doug Munch, St. Johns River Water Management District
Catherine Walker, St. Johns River Water Management District
Ken Herd, Southwest Florida Water Management District
Jim Gross, St. Johns River Water Management District
Kevin Smith, Citrus County
Barbara Vergara, St. Johns River Water Management District
Angel Martin, Southwest Florida Water Management District
Miki Renner, Southwest Florida Water Management District

Southwest Florida Water Management District Governing Board Members

Todd Pressman, Chair, Pinellas
Ronald E. Oakley, Vice Chair, Pasco
Hugh M. Gramling, Secretary, Hillsborough
Neil Combee, Former chair, Polk
Judy Whitehead, Former chair, Hernando
Jeffrey Adams, Pinellas
Carlos Beruff, Manatee
Bryan K. Beswick, DeSoto
Jennifer E. Closshey, Hillsborough
Albert G. Joerger, Sarasota
Maritza Rovira-Forino, Hillsborough
H. Paul Senft, Jr., Polk
Douglas B. Tharp, Sumter

SWFWMD Withlacoochee River Basin Board Members

Ronald E. Oakley, Co-Chair
Douglas B. Tharp, Co-Chair
Albert L. "Bo" Rooks, Vice Chair
Martha Jane Baldwin, Secretary, Brooksville
William "Bill" J. Bachschmidt, Inglis
John "Jack" Dennis, Dunnellon
Candy Nathe, Dade City
Kelly S. Rice, Webster

SWFWMD Coastal Rivers Basin Board Members

Judith Whitehead, Chair
William Y. Bunch, Crystal River
Richard J. Matassa, Spring Hill
Fritz H. Musselmann, Spring Hill

WRWSA – Detailed Water Supply Feasibility Analyses

Report Collaborators

HydroGeoLogic

URS

Janicki Environmental

The Withlacoochee Regional Water Supply Authority Water Supply Phase II – Detailed Water Supply Feasibility Analysis was co-funded by the Southwest Florida Water Management District Withlacoochee River and Coastal Rivers Basin Boards to ensure the long-term sustainability of water resources.



CERTIFICATION

This "Phase II - Detailed Water Supply Feasibility Analyses" was prepared for the Withlacoochee Regional Water Supply Authority by the undersigned.

Joshua P. Schmitz, P.E.
Florida Registration No. 64059
Professional Wetland Scientist No. 1987

Water Resource Associates, Inc.

Varut Guvanasen, Ph.D., P.E.
Florida Registration No. 49883

HydroGeoLogic, Inc.

Date: _____

Table of Contents

List of Figures	xviii
List of Tables	xxiii
Acronyms	xxviii

Executive Summary

A. Introduction	ES-1
B. WRWSA Detailed Water Supply Feasibility Study	ES-1
C. Population and Water Demands within the WRWSA	ES-1
D. Water-Resource Minimum Flows and Levels (MFLs)	ES-2
E. Regional Groundwater Assessment	ES-3
F. Water Conservation	ES-4
G. Reclaimed Water	ES-4
H. Water Supply Project Ranking	ES-5
I. Water Supply Project Options	ES-5
1. Potable Traditional Water Supply Development	ES-5
2. Potable Alternative Water Supply Planning	ES-6
J. Proposed Regional Framework for Future Water Supply	ES-7
K. Recommendations	ES-8

I. – Introduction

A. Withlacoochee Regional Water Supply Authority	I-1
B. Planning History	I-2
C. WRWSA Detailed Water Supply Feasibility Study	I-3
D. Document Structure	I-3

Chapter 1 – Population and Water Demand

1.0 Key Points	1-1
1.1 Introduction	1-1
1.2 General Assumptions	1-2

WRWSA – Detailed Water Supply Feasibility Analyses

1.3	Public Supply Water Demand	1-3
1.3.1	Introduction.....	1-3
1.3.2	Base Year Populations.....	1-3
1.3.3	Base Year Water Use.....	1-3
1.3.4	Population Projections.....	1-4
1.3.5	Public Supply Water Demand Projections.....	1-4
1.3.5.1	Planning Horizon (2005 – 2030).....	1-4
1.3.6	Results	1-4
1.3.7	Summary	1-12
1.4	Domestic Self-Supply Water Demand.....	1-12
1.4.1	Introduction.....	1-12
1.4.2	Base Year Populations.....	1-13
1.4.3	Base Year Water Use.....	1-13
1.4.4	Population Projections.....	1-13
1.4.5	Domestic Self-Supply Water Demand Projections	1-13
1.4.5.1	Planning Horizon (2005 – 2030).....	1-13
1.4.6	Results	1-13
1.4.7	Summary	1-14
1.5	Commercial, Industrial, Mining/Dewatering and Power Water Demand	1-14
1.5.1	Introduction.....	1-14
1.5.2	Base Year.....	1-15
1.5.3	Water Demand Projections	1-15
1.5.4	Results	1-15
1.5.5	Summary	1-16
1.6	Recreational/Aesthetics Water Demand	1-16
1.6.1	Introduction.....	1-16
1.6.2	Base Year.....	1-16
1.6.3	Water Demand Projections	1-16
1.6.4	Results	1-18
1.6.5	Summary	1-18
1.7	Agricultural Water Demand	1-19
1.7.1	Introduction.....	1-19
1.7.2	Base Year.....	1-19
1.7.3	Water Demand Projections	1-19

1.7.4	Results	1-21
1.7.5	Summary	1-21
1.8	Total WRWSA Water Demand	1-22
1.8.1	Summary	1-22
1.9	Uncertainties and Issues with Projecting Public Supply Water Demand in the WRWSA	1-24

Chapter 2 – Water Resource Minimum Flows and Levels

2.0	Key Points	2-1
2.1	Introduction.....	2-1
2.2	Minimum Flow and Level Priority Lists and Schedules	2-2
2.3	Approaches to Proxy Minimum Flows and Levels – Springs and Rivers	2-4
2.4	Proxy Minimum Flows for Selected Springs.....	2-5
2.4.1	Withlacoochee Regional Water Supply Authority – Site Specific Considerations for Development of Proxy Threshold Methodology	2-5
2.4.2	Guidance Springs for Development of Proxy Thresholds	2-5
2.4.2.1	Criteria – Spring Magnitude and Water Resource Values.....	2-5
2.4.2.2	Suwannee River Water Management District Springs MFLs	2-6
2.4.2.3	St. John’s River Water Management District Springs MFLs	2-8
2.4.2.4	Southwest Florida Water Management District	2-8
2.4.3	Proxy Thresholds for Selected Springs	2-9
2.4.3.1	Chassahowitzka Spring.....	2-9
2.4.3.2	Homosassa Spring.....	2-9
2.4.3.3	Crystal River.....	2-10
2.4.3.4	Gum and Citrus Blue Springs.....	2-10
2.5	Proxy Minimum Flows for the Withlacoochee River – Site-Specific Considerations for Development of Proxy Threshold Methodology	2-11
2.5.1	SWFWMD Approach to River MFLs.....	2-11
2.5.2	Definition of Seasonal Flow Blocks	2-12
2.5.3	The Low-Flow and High-Flow Thresholds.....	2-12
2.5.4	Estimation of Proxy Thresholds.....	2-13
2.5.4.1	Alafia River MFL Methodology Summary	2-13
2.5.4.2	Hillsborough River MFL Methodology Summary	2-13
2.5.4.3	Myakka River MFL Methodology Summary	2-14

2.5.4.4	Peace River MFL Methodology Summary.....	2-14
2.5.5	Application of Proxy Thresholds to the Withlacoochee River.....	2-15
2.5.5.1	Hydrological Characterization of Gages of Interest.....	2-15
2.5.5.2	Low-flow Proxy Threshold Estimation	2-17
2.5.5.3	High-flow Proxy Threshold Estimation	2-18
2.5.5.4	Percent-of-flow Reduction Recommendation.....	2-19
2.5.5.5	MFL-Adjusted Hydrographs for the Upper Withlacoochee River	2-19
2.6	Lower Withlacoochee River and Lake Rousseau.....	2-22

Chapter 3 – Groundwater Resource Assessment

3.0	Key Points	3-1
3.1	Introduction.....	3-2
3.2	Hydrogeologic Description of the WRWSA and Vicinity.....	3-2
3.3	Application of Groundwater Flow Models.....	3-4
3.4	Groundwater Flow Models	3-4
3.4.1	Description of the SWFWMD ND Model	3-5
3.4.2	Description of the SJRWMD NCF Model	3-6
3.5	Groundwater Flow Simulation Considerations	3-7
3.5.1	Northern Sumter, Southern Marion and Northern Lake County Hydrogeology	3-7
3.5.1.1	Hydrogeologic Sensitivity Analyses.....	3-8
3.5.2	Water Management District Boundaries.....	3-10
3.5.3	Existing Water Use Permit Considerations	3-10
3.5.4	Data Collection and Future Model Refinement	3-11
3.6	Projected Groundwater Withdrawals.....	3-12
3.6.1	Groundwater Withdrawals within the WRWSA.....	3-12
3.6.2	Groundwater Withdrawals outside the WRWSA	3-13
3.7	SWFWMD Northern District Groundwater Modeling Results – Estimated and Projected	3-14
3.7.1	Estimated Pre-Development Conditions	3-14
3.7.2	Projected 2030 Evaluation	3-15
3.7.2.1	2030 Methodology.....	3-15
3.7.2.2	2030 Simulations.....	3-15

3.7.2.3	ND Modeling Results.....	3-16
3.7.2.3.1	Aquifer Drawdown	3-16
3.7.2.3.2	Spring Flows.....	3-18
3.7.3	Other Northern District Model Analyses	3-19
3.7.3.1	Existing Water Use Permit Considerations	3-19
3.7.3.2	Orange County	3-19
3.8	SJRWMD North Central Florida Groundwater Modeling Results – Estimated and Projected	3-20
3.8.1	Estimated 1995 Conditions	3-20
3.8.2	Projected 2030 Evaluation	3-20
3.8.2.1	2030 Methodology.....	3-20
3.8.2.2	NCF Modeling Results	3-21
3.8.2.2.1	Aquifer Drawdown	3-21
3.8.2.2.2	Spring Flows.....	3-21
3.8.3	Other NCF Model Analyses.....	3-21
3.8.3.1	Model Boundaries	3-22
3.8.3.2	Recharge Sensitivity.....	3-22
3.9	Potential Impact to Groundwater Resources.....	3-23
3.9.1	Effect on Spring Flows	3-23
3.9.1.1	Citrus County.....	3-23
3.9.1.2	Hernando County	3-24
3.9.1.3	Sumter County	3-24
3.9.1.4	Marion County	3-24
3.9.2	Effect on Lakes and Wetlands.....	3-25
3.9.2.1	Citrus County.....	3-25
3.9.2.2	Hernando County	3-25
3.9.2.3	Sumter County	3-26
3.9.2.4	Marion County	3-27
3.9.3	Effect on Seepage Contributions to River Systems	3-30
3.9.3.1	Discussion of River Seepage Results and Proxy MFLs	3-31
3.10	Water Supply and Projected Aquifer Level Decline.....	3-32
3.10.1	Citrus County.....	3-32
3.10.2	Hernando County	3-32
3.10.3	Sumter County	3-33

3.10.4	Marion County	3-33
3.10.5	Lower Floridan Aquifer	3-34
3.11	Groundwater Resource Assessment Summary	3-34

Chapter 4 – The Role of Water Conservation within the WRWSA

4.0	Key Points	4-1
4.1	Introduction.....	4-1
4.2	Regulatory Requirements for Enhanced Conservation	4-2
4.3	WRWSA Water Conservation Programs and Initiatives	4-3
4.4	WRWSA Member Government Water Conservation Programs and Initiatives	4-4
4.4.1	Regulation	4-4
4.4.2	Education Programs.....	4-9
4.4.3	Incentives	4-13
4.5	SWFWMD Non-Agricultural Water Conservation Modeling	4-15
4.5.1	Methodology.....	4-16
4.5.2	WRWSA Member Government Water Conservation Savings Potential.....	4-16
4.6	Rate Structures	4-19
4.6.1	Inverted Conservation Rate Structures	4-19
4.7	Watering Restriction Enforcement.....	4-21
4.8	WRWSA Regional Outdoor Irrigation Audit Program	4-21

Chapter 5 – Reclaimed Water Projects

5.0	Key Points	5-1
5.1	Introduction.....	5-1
5.2	Phase II Update.....	5-2
5.3	Phase II Screening	5-3
5.4	Reuse Water Quality Standards.....	5-3
5.5	Beneficial Reuse Conceptual Design	5-4
5.5.1	Biological Treatment Process.....	5-5
5.5.2	Tertiary Filtration	5-5
5.5.3	Disinfection.....	5-5

5.5.4	Effluent Storage.....	5-5
5.5.5	Reclaimed Water Transmission	5-5
5.5.6	Downstream Users.....	5-6
5.6	Conceptual Cost Estimates	5-6
5.6.1	Cost Definitions	5-6
5.6.2	Capital Cost Estimates	5-7
5.6.2.1	Brookridge Subregional WWTP	5-7
5.6.2.2	Sugarmill Woods WWTP	5-8
5.6.2.3	Dunnellon WWTF	5-9
5.6.3	Operation and Maintenance Cost Estimates.....	5-9
5.6.4	Unit Production Costs – Design Capacity	5-10
5.6.5	Unit Production Cost – Potable Offset.....	5-11
5.7	Beneficial Reuse Trends	5-11

Chapter 6 – Groundwater Project Options

6.0	Key Points	6-1
6.1	Introduction.....	6-1
6.2	Fresh Groundwater – Withdrawal Evaluations.....	6-3
6.2.1	Regional Groundwater Flow Modeling	6-3
6.2.2	Withdrawal Locations	6-3
6.2.2.1	Northern Sumter County	6-4
6.2.2.2	Southern Citrus County	6-4
6.2.2.3	Northwestern Marion County.....	6-5
6.2.2.4	Northeastern Marion County	6-5
6.2.3	Modeling Results.....	6-6
6.2.3.1	Sumter Withdrawal.....	6-6
6.2.3.2	Citrus Withdrawal	6-7
6.2.3.3	Northwestern Marion Withdrawal	6-8
6.2.3.4	Northeastern Marion Withdrawal.....	6-9
6.3	Water Supply Yield and Withdrawal Feasibility Assessment	6-10
6.3.1	Sumter Withdrawal	6-11
6.3.2	Citrus Withdrawal	6-13
6.3.3	Northwestern Marion Withdrawal	6-14

6.3.4	Northeastern Marion Withdrawal.....	6-15
6.4	Service Area Demands	6-17
6.4.1	Sumter Wellfield	6-17
6.4.2	Citrus Wellfield	6-18
6.4.3	Northwestern Marion Wellfield	6-19
6.4.4	Northeastern Marion Wellfield	6-20
6.5	Conceptual Facility Design.....	6-20
6.5.1	Basis of Design	6-21
6.5.2	Facility Components.....	6-21
6.5.2.1	Raw Water Wellfield	6-21
6.5.2.2	Water Treatment Plant	6-22
6.5.2.3.	Disinfection.....	6-22
6.5.2.4	Finished Water Storage.....	6-22
6.5.2.5	Finished Water Pump Station.....	6-23
6.5.2.6	Support Facilities.....	6-23
6.6	Transmission Systems	6-23
6.6.1	Conceptual Transmission Design.....	6-23
6.6.2	Sumter Wellfield	6-24
6.6.3	Citrus Wellfield	6-25
6.6.4	Northwestern Marion Wellfield	6-25
6.6.5	Northeastern Marion Wellfield	6-26
6.7	Conceptual Cost Estimate.....	6-26
6.7.1	Cost Definitions	6-26
6.7.2	Capital Cost Estimates	6-27
6.7.3	Operation and Maintenance Cost Estimates.....	6-28
6.7.4	Unit Production Cost	6-30
6.8	Implementation Considerations.....	6-31
6.9	Summary	6-32

Chapter 7 – Aquifer Recharge Project Option

7.0	Key Points	7-1
7.1	Project Description	7-1
7.2	Areas and Users Served	7-2

7.3	Design Criteria and Assumptions	7-2
7.3.1	Site Selection	7-2
7.3.2	Reservoir Design.....	7-2
7.3.3	Hydrogeology of Recharge Area	7-3
7.3.4	Hydrogeologic Recharge Potential.....	7-3
7.3.5	UFA Water Quality Issues	7-4
7.3.6	River Intake Structure.....	7-4
7.3.7	Withlacoochee River Withdrawals.....	7-4
7.3.8	Design Recharge Benefit	7-5
7.4	Conceptual Cost Estimate.....	7-6
7.4.1	Cost Definitions	7-6
7.4.2	Capital Cost Estimate.....	7-6
7.4.3	Operation and Maintenance Cost Estimate.....	7-7
7.4.4	Unit Production Cost	7-7
7.5	Other Potential Project Benefits	7-7
7.6	Summary	7-8

Chapter 8 – Surfacewater Project Options

8.0	Key Points	8-1
8.1	The Role of Potable Alternative Water Supply in the WRWSA	8-1
8.2	Water Supply Yield – Withlacoochee River.....	8-3
8.2.1	Croom Gage.....	8-3
8.2.2	Wysong-Coogler Gage.....	8-5
8.2.3	Holder Gage	8-7
8.2.4	Lake Rousseau	8-9
8.3	Water Supply Yield – Lower Ocklawaha River.....	8-9
8.4	Service Area Demands	8-10
8.5	Surfacewater Project Options in the WRWSA.....	8-10
8.6	Withlacoochee River Facilities	8-12
8.6.1	North Sumter.....	8-12
8.6.2	Near Holder.....	8-12
8.6.3	Lake Rousseau	8-12
8.6.4	River Intake	8-13

8.6.5	Raw Water Pump Station	8-13
8.7	Conceptual Design of Raw Water Storage Reservoir	8-13
8.7.1	Reservoir Size	8-14
8.7.2	Structural Geology Evaluation	8-14
8.7.3	Hydrogeologic Evaluation	8-14
8.7.4	Reservoir Construction	8-15
8.7.5	Transfer Pump Station	8-15
8.8	Conceptual Water Treatment Facility Design	8-15
8.8.1	Basis of Design	8-16
8.8.2	Water Treatment Plant	8-16
8.8.2.1	Powdered Activated Carbon System	8-17
8.8.2.2	Coagulation / Ballasted Flocculation / Sedimentation System	8-17
8.8.2.3	Filtration System	8-18
8.8.2.4	Disinfection	8-18
8.8.2.5	Finished Water Storage	8-18
8.8.2.6	Finished Water Pump Station	8-19
8.8.2.7	Residuals Management	8-19
8.8.3	Conceptual Site Layout	8-19
8.8.4	Support Facilities	8-20
8.9	Transmission Systems	8-20
8.9.1	Conceptual Transmission Design	8-21
8.9.2	North Sumter	8-21
8.9.3	Holder	8-22
8.9.4	Lake Rousseau Surfacewater	8-22
8.9.5	Blending	8-23
8.10	Conceptual Cost Estimate	8-24
8.10.1	Cost Definitions	8-24
8.10.2	Capital Cost Estimates	8-25
8.10.3	Operation and Maintenance Cost Estimates	8-26
8.10.4	Unit Production Cost Estimates	8-27
8.11	Long-Range Planning Considerations	8-28

Chapter 9 – Seawater Desalination Project Option

9.0	Key Points	9-1
9.1	The Role of Potable Alternative Water Supply in the WRWSA Region.....	9-1
9.2	Seawater Desalination Project Description	9-2
9.3	Design Capacity	9-3
9.4	Seawater Source and Intake Location	9-3
9.5	Conceptual Facility Design.....	9-4
9.5.1	Basis of Design	9-5
9.5.2	Water Treatment Facility	9-5
9.5.2.1	Water Treatment Plant	9-5
9.5.2.2	Raw Water Intake.....	9-5
9.5.2.3	Raw Water Pump Station and Transmission.....	9-6
9.5.2.4	Pretreatment.....	9-6
9.5.2.5	Membrane RO Treatment	9-6
9.5.2.6	Disinfection and Stabilization	9-6
9.5.2.7	Finished Water Storage.....	9-7
9.5.2.8	Finished Water Pump Station.....	9-7
9.5.3	Support Facilities.....	9-7
9.5.4	Environmental Monitoring.....	9-8
9.6	Transmission Systems	9-8
9.6.1	Conceptual Transmission Design.....	9-8
9.6.2	Blending Water with Utility Distribution Systems.....	9-9
9.7	Conceptual Cost Estimate.....	9-10
9.7.1	Cost Definitions	9-10
9.7.2	Capital Cost Estimates	9-10
9.7.3	Operation and Maintenance Cost Estimate.....	9-11
9.7.4	Unit Production Cost	9-12

Chapter 10 – Evaluation and Ranking of Water Supply Projects

10.0	Key Points	10-1
10.1	Introduction.....	10-1
10.2	Feasibility Evaluation Criteria	10-2

10.3	Evaluation of Potential Water Supply Projects	10-2
10.3.1	Water Conservation.....	10-3
10.3.1.1	Project Description	10-3
10.3.1.2	Environmental Impacts.....	10-3
10.3.1.3	Ability to Permit	10-3
10.3.1.4	Public Perception	10-3
10.3.1.5	Long-Term Viability of Source	10-3
10.3.1.6	Costs	10-3
10.3.1.7	Ability to Service Multiple Users	10-4
10.3.1.8	Estimated Time to Implement.....	10-4
10.3.1.9	Overall Project Grade.....	10-4
10.3.2	Sumter Wellfield	10-4
10.3.2.1	Project Description	10-4
10.3.2.2	Environmental Impacts.....	10-5
10.3.2.3	Ability to Permit	10-5
10.3.2.4	Public Perception	10-6
10.3.2.5	Long-Term Viability of Source	10-46
10.3.2.6	Costs	10-6
10.3.2.7	Ability to Serve Multiple Users.....	10-7
10.3.2.8	Estimated Time to Implement.....	10-7
10.3.2.9	Overall Project Grade.....	10-7
10.3.3	Citrus Wellfield	10-7
10.3.3.1	Project Description	10-7
10.3.3.2	Environmental Impacts.....	10-8
10.3.3.3	Ability to Permit	10-8
10.3.3.4	Public Perception	10-9
10.3.3.5	Long-Term Viability of Source	10-9
10.3.3.6	Costs	10-9
10.3.3.7	Ability to Serve Multiple Users.....	10-10
10.3.3.8	Estimated Time to Implement.....	10-10
10.3.3.9	Overall Project Grade.....	10-10
10.3.4	Northwestern Marion Wellfield	10-10
10.3.4.1	Project Description	10-10

10.3.4.2	Environmental Impacts.....	10-11
10.3.4.3	Ability to Permit	10-11
10.3.4.4	Public Perception	10-12
10.3.4.5	Long-Term Viability of Source	10-12
10.3.4.6	Costs	10-12
10.3.4.7	Ability to Serve Multiple Users.....	10-13
10.3.4.8	Estimated Time to Implement.....	10-13
10.3.4.9	Overall Project Grade.....	10-13
10.3.5	Northeaster Marion Wellfield	10-13
10.3.5.1	Project Description	10-13
10.3.5.2	Environmental Impacts.....	10-14
10.3.5.3	Ability to Permit	10-15
10.3.5.4	Public Perception	10-15
10.3.5.5	Long-Term Viability of Source	10-15
10.3.5.6	Costs	10-16
10.3.5.7	Ability to Serve Multiple Users.....	10-16
10.3.5.8	Estimated Time to Implement.....	10-16
10.3.5.9	Overall Project Grade.....	10-16
10.3.6	Lake Rousseau	10-16
10.3.6.1	Project Description	10-16
10.3.6.2	Environmental Impacts.....	10-17
10.3.6.3	Ability to Permit	10-17
10.3.6.4	Public Perception	10-17
10.3.6.5	Long-Term Viability of Source	10-18
10.3.6.6	Cost.....	10-18
10.3.6.7	Ability to Serve Multiple Users.....	10-18
10.3.6.8	Estimated Time to Implement.....	10-18
10.3.6.9	Overall Project Grade.....	10-18
10.3.7	Withlacoochee River near Holder – Reservoir	10-19
10.3.7.1	Project Description	10-19
10.3.7.2	Environmental Impacts.....	10-19
10.3.7.3	Ability to permit.....	10-20
10.3.7.4	Public Perception	10-20
10.3.7.5	Long-Term Viability of Source	10-20

10.3.7.6	Cost.....	10-20
10.3.7.7	Ability to Serve Multiple Users.....	10-21
10.3.7.8	Estimated Time to Implement.....	10-21
10.3.7.9	Overall Project Grade.....	10-21
10.3.8	North Sumter “Conjunctive Use” Surfacewater Supply	10-21
10.3.8.1	Project Description	10-21
10.3.8.2	Environmental Impacts.....	10-22
10.3.8.3	Ability to Permit	10-22
10.3.8.4	Public Perception	10-22
10.3.8.5	Long-Term Viability of Source	10-23
10.3.8.6	Cost.....	10-23
10.3.8.7	Ability to Serve Multiple Users.....	10-23
10.3.8.8	Estimated Time to Implement.....	10-23
10.3.8.9	Overall Project Grade.....	10-23
10.3.9	Withlacoochee River Aquifer Recharge near Trilby	10-24
10.3.9.1	Project Description	10-24
10.3.9.2	Environmental Impacts.....	10-24
10.3.9.3	Ability to Permit	10-25
10.3.9.4	Public Perception	10-25
10.3.9.5	Long-Term Viability of Source	10-25
10.3.9.6	Cost.....	10-25
10.3.9.7	Ability to Serve Multiple Users.....	10-26
10.3.9.8	Estimated Time to Implement.....	10-26
10.3.9.9	Overall Project Grade.....	10-26
10.3.10	Desalination near Crystal River Power Plant	10-26
10.3.10.1	Project Description	10-26
10.3.10.2	Environmental Impacts.....	10-27
10.3.10.3	Ability to permit.....	10-27
10.3.10.4	Public Perception	10-27
10.3.10.5	Long-Term Viability of Source	10-27
10.3.10.6	Cost.....	10-28
10.3.10.7	Ability to Serve Multiple Users.....	10-28
10.3.10.8	Estimated Time to Implement.....	10-28
10.3.10.9	Overall Project Grade.....	10-28

10.4	The Role of the Lower Ocklawaha River	10-28
10.5	Coquina Coast Seawater Desalination.....	10-29

Chapter 11 – Water Resources, Supplies and Demand

11.0	Key Points	11-1
11.1	Introduction.....	11-2
11.2	Water Conservation.....	11-2
11.3	Reclaimed Water.....	11-3
11.4	Regional Approaches to Water Supply Planning and Development	11-4
11.5	Short-Term Water Supply Planning and Development (1 – 20 Years).....	11-6
11.6	Mid-Term Water Supply Planning and Development (15 – 35 Years)	11-7
11.7	Long-Term Water Supply Planning and Development (30 – 50 Years)	11-7

Chapter 12 – WRWSA Regional Water Supply Framework

12.0	Key Points	12-1
12.1	Introduction.....	12-1
12.2	Regionalization within the WRWSA	12-2
12.3	WRWSA Regional Framework	12-4
12.3.1	Assumptions for WRWSA Regional Framework	12-4
12.3.2	Evolution of a Regional Framework for the WRWSA	12-5
12.3.2.1	Short-Term Water Supply Development	12-5
12.3.2.2	Mid-Term Regional Interconnects	12-6
12.3.2.3	Long-Term Introduction of AWS.....	12-6
12.3.2.4	Incentives for Regionalization	12-6
12.3.2.5	Next Steps for Development of the WRWSA Framework	12-7

Chapter 13 – Recommendations

13.0	Introduction.....	13-1
13.1	Population and Water Demand	13-1
13.1.1	Population and Projected Water Demand Updates.....	13-1
13.1.2	Tracking of Water Use Types and Quantities.....	13-1

WRWSA – Detailed Water Supply Feasibility Analyses

13.1.3	Large Water Use Tracking	13-1
13.1.4	Domestic Self-Supply Water Consumption	13-1
13.2	Hydrogeologic Data Collection and Resource Monitoring	13-2
13.2.1	Monitor Lower Floridan Aquifer (LFA) and Surficial Aquifer Data Collection Activities	13-2
13.2.2	Develop and Coordinate Resource Monitoring Program between SWFWMD and SJRWMD in Northern Sumter and Southern Marion County	13-2
13.2.3	Funding for Hydrogeologic Studies	13-2
13.3	Regional Groundwater Assessment.....	13-3
13.3.1	Groundwater Models	13-3
13.3.2	Groundwater Model Boundary Conditions	13-3
13.3.3	Resource Assessment	13-3
13.3.3.1	MFLs	13-3
13.3.3.2	Surficial Aquifer System and Surficial Resources	13-4
13.4	Water Conservation.....	13-4
13.4.1	WRWSA Role in Regional Water Conservation	13-4
13.4.2	SWFWMD Compliance Per Capita	13-4
13.4.3	“SWFWMD Non-Agricultural Water Conservation Modeling (SWFWMD Model)	13-5
13.5	Reclaimed Water.....	13-5
13.5.1	WRWSA Role in Regional Reclaimed Water Supply Planning	13-5
13.5.2	Subregional Planning – WRWSA Reclaimed Water Implementation Plan (Reclaimed Plan).....	13-5
13.5.3	WRWSA Reclaimed Water Workgroup	13-6
13.5.4	Cost-Share Funding for Beneficial Reuse Projects	13-6
13.6	Water Supply Project Options	13-6
13.6.1	Potable Traditional Water Supply Development.....	13-6
13.6.2	Potable Alternative Water Supply Planning.....	13-6
13.6.3	Pipeline Corridors.....	13-7
13.6.4	Land Acquisition	13-7
13.6.5	Lake Rousseau	13-8
13.6.6	Seawater Desalination at Crystal River.....	13-8
13.7	Water Supply Partnership Opportunities	13-8
13.7.1	Incentives for Regional Water Supply Development	13-8

13.7.2	AWS Permit Conditions and Resource Evaluation.....	13-9
13.7.3	10-Year Water Supply Facility Workplans.....	13-9
13.8	WRWSA Water Supply Regional Framework	13-9
13.8.1	Visioning.....	13-9
13.8.2	Governance.....	13-9
13.8.3	Funding	13-9

Appendices

Appendix Levy

Appendix SWFWMD Water Conservation Model

List of Figures

Introduction

Figure I-1 WRWSA Location Map

Chapter 1

Figure 1-1A Incorporated / Unincorporated Citrus County Existing and Projected Water Demand

Figure 1-1B Incorporated / Unincorporated Citrus County Existing and Projected Water Demand

Figure 1-2A Incorporated / Unincorporated Hernando County Existing and Projected Water Demand

Figure 1-2B Incorporated / Unincorporated Hernando County Existing and Projected Water Demand

Figure 1-3A Incorporated / Unincorporated Sumter County Existing and Projected Water Demand

Figure 1-3B Incorporated / Unincorporated Sumter County Existing and Projected Water Demand

Figure 1-4A Incorporated / Unincorporated Marion County Existing and Projected Water Demand

Figure 1-4B Incorporated / Unincorporated Marion County Existing and Projected Water Demand

Figure 1-5A Total Existing and Projected Water Demand for the WRWSA

Figure 1-5B Total Existing and Projected Water Demand for the WRWSA

Chapter 2

Figure 2-1 MFL Priority Rivers

Figure 2-2 MFL Priority Springs

Figure 2-3 MFL Priority Lakes

Figure 2-4 Proxy MFL Locations

Figure 2-5 Median daily flows from 1928 through 2006 on the Withlacoochee River at the USGS gage at Holder, FL, by seasonal flow block

Figure 2-6 Median daily flows from 1928 through 2006 on the Withlacoochee River at the USGS gage at Trilby, FL, by seasonal flow block

- Figure 2-7 Median daily flows from 1939 through 2006 on the Withlacoochee River at the USGS gage at Croom, FL, by seasonal flow block
- Figure 2-8 Median daily (blue line) and hypothetical MFL-adjusted (green line) flows from 1939 through 2006 on the Withlacoochee River at the USGS gage at Holder, FL, by seasonal flow block
- Figure 2-9 Median daily (blue line) and hypothetical MFL-adjusted (green line) flows from 1939 through 2006 on the Withlacoochee River at the USGS gage at Trilby, FL, by seasonal flow block
- Figure 2-10 Median daily (blue line) and hypothetical MFL-adjusted (green line) flows from 1939 through 2006 on the Withlacoochee River at the USGS gage at Croom, FL, by seasonal flow block

Chapter 3

- Figure 3-1 WRWSA and Vicinity
- Figure 3-2 Project Region Hydrostratigraphic Interpretation
- Figure 3-3 Approximate MFL Priority Springsheds in WRWSA
- Figure 3-4 WRWSA Utilization of Groundwater Flow Models
- Figure 3-5 ND Model Groundwater Basins
- Figure 3-6 The ND Model Grid
- Figure 3-7 ICU Distribution in the ND Model
- Figure 3-8 UFA Transmissivity Distribution in the ND Model
- Figure 3-9 LFA Transmissivity Distribution in the ND Model
- Figure 3-10 The NCF Model Grid
- Figure 3-11 Unconfined/Confined Areas in the NCF Model
- Figure 3-12 UFA Transmissivity in the NCF Model
- Figure 3-13 LFA Transmissivity in the NCF Model
- Figure 3-14 ND Model Potentiometric Surface Distribution at Predevelopment: SA
- Figure 3-15 ND Model Potentiometric Surface Distribution at Predevelopment: UFA
- Figure 3-16 ND Model Cumulative Drawdown Distribution in 2030: Surficial Aquifer, High Withdrawal Simulation
- Figure 3-17 ND Model Cumulative Drawdown Distribution in 2030: Upper Floridan Aquifer, High Withdrawal Simulation
- Figure 3-18 ND Model Cumulative Drawdown Distribution in 2030: Surficial Aquifer, Medium Withdrawal Simulation

- Figure 3-19 ND Model Cumulative Drawdown Distribution in 2030: Upper Floridan Aquifer, Medium Withdrawal Simulation
- Figure 3-20 ND Model 7 MGD Sensitivity Analysis UFA Response
- Figure 3-21 ND Model SA Drawdown Due to Eastern Boundary Condition Withdrawals 1995 – 2013
- Figure 3-22 ND Model UFA Drawdown Due to Eastern Boundary Condition Withdrawals 1995 – 2013
- Figure 3-23 NCF Model Potentiometric Surface Distribution at 1995: SA
- Figure 3-24 NCF Model Potentiometric Surface Distribution at 1995: UFA
- Figure 3-25 NCF Model Change in Recharge 1995 – 2030
- Figure 3-26 NCF Model 1995 Drawdown Distribution in 2030: Surficial Aquifer
- Figure 3-27 NCF Model 1995 Drawdown Distribution in 2030: Upper Florida Aquifer
- Figure 3-28 NCF Model SA Drawdown Due to Boundary Condition Withdrawals 1995 – 2013
- Figure 3-29 NCF Model UFA Drawdown Due to Boundary Condition Withdrawals 1995 – 2013
- Figure 3-30 NCF Model SA Change Due to Recharge 1995 – 2030
- Figure 3-31 NCF Model UFA Change Due to Recharge 1995 – 2030
- Figure 3-32 NCF Model SA Likelihood of Harm Analysis
- Figure 3-33 NCF Model Unconfined UFA Likelihood of Harm Analysis
- Figure 3-34 NCF Model SA Likelihood of Harm Analysis Sensitivity to Constant Recharge
- Figure 3-35 Variation in NCF and ND Model Conceptualization of SA

Chapter 4

- Figure 4-1 Selected Residential Public Supply Rate Structures
- Figure 4-2 Water Demand Curve and Rate Structure Effectiveness

Chapter 5

- Figure 5-1 Domestic Wastewater Treatment Plants in the WRWSA
- Figure 5-2 Selected Wastewater Treatment Plants

Chapter 6

Figure 6-1	Fresh Groundwater Project Options
Figure 6-2	Withdrawal Modeling Configurations
Figure 6-3	ND Model: Sumter Wellfield UFA Drawdown
Figure 6-4	ND Model: Citrus Wellfield UFA Drawdown
Figure 6-5	ND Model: Northwestern Marion Wellfield UFA Drawdown
Figure 6-6	NCF Model: Northeastern Marion Wellfield SA Drawdown
Figure 6-7	NCF Model: Northeastern Marion Wellfield UFA Drawdown
Figure 6-8	Water Treatment Plant Conceptual Process Flow Diagram
Figure 6-9	Conceptual Water Treatment Plant Layout
Figure 6-10	Conceptual Sumter Wellfield Transmission Route
Figure 6-11	Conceptual Citrus Wellfield Transmission Route
Figure 6-12	Conceptual Northwestern Marion Wellfield Transmission Route
Figure 6-13	Conceptual Northeastern Marion Wellfield Transmission Route

Chapter 7

Figure 7-1	Project Location Map Conceptual Aquifer Recharge Facility
Figure 7-2	UFA Potentiometric Surface – 2005 Conceptual Aquifer Recharge Facility
Figure 7-3	5 Foot Contour Elevations Conceptual Aquifer Recharge Facility
Figure 7-4A	Geologic Map of Hernando County
Figure 7-4B	Geologic Map of Hernando County
Figure 7-5	Withlacoochee River Stage - Trilby
Figure 7-6	Site Plan Conceptual Aquifer Recharge Facility

Chapter 8

Figure 8-1	Potable Surfacewater Project Options
Figure 8-2	North Sumter Project Location
Figure 8-3	Holder Project Location
Figure 8-4	Lake Rousseau Project Location
Figure 8-5	Holder Vicinity Surface Geology

Figure 8-6	Holder Vicinity Geologic Legend
Figure 8-7	Surfacewater Treatment Process Flow Diagram
Figure 8-8	Surfacewater Treatment Facility Layout
Figure 8-9	Conceptual North Sumter Transmission Route
Figure 8-10	Conceptual Holder Transmission Route
Figure 8-11	Conceptual Lake Rousseau Transmission Route

Chapter 9

Figure 9-1	Progress Energy Crystal River Power Plant
Figure 9-2	Cross Florida Barge Canal Salinity at Mouth
Figure 9-3	General Location of Seawater Desalination Facility
Figure 9-4	Seawater Desalination Process Flow Diagram
Figure 9-5	Conceptual Seawater Desalination Transmission Route

Chapter 12

Figure 12-1	WRWSA Public Water Supply Demand Projections Comparison
Figure 12-2	Regional Framework Short-Term Groundwater Development
Figure 12-3	Regional Framework Mid-Term Regional Interconnects
Figure 12-4	Regional Framework Long-Term Introduction of AWS

List of Tables

Chapter 1

Table 1-1A	Public Supply Methodology and Assumptions
Table 1-1B	Domestic Self-Supply Methodology and Assumptions
Table 1-2	Existing and Projected Water Demand for Phase II
Table 1-3A	Citrus County Public Supply Water Demand and Population
Table 1-3B	Hernando County Public Supply Water Demand and Population
Table 1-3C	Sumter County Public Supply Water Demand and Population
Table 1-3D	Marion County Public Supply Water Demand and Population

Chapter 2

Table 2-1	Adopted MFL Waterbodies within the Withlacoochee Regional Water Supply Authority
Table 2-2	MFL Schedule for Priority Waterbodies within the Withlacoochee Regional Water Supply Authority
Table 2-3	Summary of Existing Springs MFLs in Three Water Management Districts
Table 2-4	Summary of Proxy Threshold Ranges for Three Gages on the Upper Withlacoochee River
Table 2-5	Percent-of-flow Reductions Recommended for the Upper Withlacoochee River, by Seasonal Block
Table 2-6	Estimated Proxy Threshold for Three Gages on the Upper Withlacoochee River

Chapter 3

Table 3-1	Modeled Villages Extraction Rates from the Upper and Lower Floridan aquifers in 2030
Table 3-2	Summary of 2030 ND Model Pumpage in WRWSA
Table 3-3	Summary of 2030 NCF Model Pumpage in WRWSA
Table 3-4	Summary of 2030 ND Model Pumpage Outside WRWSA
Table 3-5	Summary of 2030 NCF Model Pumpage Outside WRWSA
Table 3-6	ND Model Simulations for Projected 2030 Withdrawals

Table 3-7	ND Model WRWSA Spring Discharge Rates
Table 3-8	ND Model WRWSA Spring Discharge Rate Ratios
Table 3-9	NCF Model WRWSA Spring Discharge Rates
Table 3-10	NCF Model WRWSA Spring Discharge Rate Ratios
Table 3-11	Comparison of Projected Groundwater Use in PWRCA in Flagler, Lake and Volusia Counties
Table 3-12	Summary of Cumulative Withlacoochee River Gain/Loss Rates
Table 3-13	Summary of Cumulative Withlacoochee River Gain/Loss Rate Ratios

Chapter 4

Table 4-1	Conservation Program Inventory
Table 4-2	Water Conservation Savings Potential in WRWSA Based on SWFWMD Non-Agricultural Conservation Model

Chapter 5

Table 5-1	Summary of Reuse Activities
Table 5-2	WWTPs Current and Projected Flows
Table 5-3	Public Access Reuse Water Quality Standards
Table 5-4	Selected WWTPs Current and Projected 2030 Capacities
Table 5-5	Brookridge WWTP Capital Costs
Table 5-6	Sugarmill Woods WWTP Capital Costs
Table 5-7	Dunnellon WWTP Capital Costs
Table 5-8	Reuse Project Operation and Maintenance Cost Estimates
Table 5-9	Brookridge Subregional WWTF: 0.75 mgd Unit Production Cost Estimate
Table 5-10	Sugarmill Woods WWTF. 1.0 mgd Unit Production Cost Estimate
Table 5-11	Dunnellon WWTF. 0.25 mgd Unit Production Cost Estimate
Table 5-12	Unit Production Cost – Potable Offset

Chapter 6

Table 6-1	Simulated Effects on Spring Discharge – Sumter Wellfield
Table 6-2	Simulated Effect on Withlacoochee River Gain / Loss – Sumter County Wellfield
Table 6-3	Simulated Effects on Spring Discharge – Citrus County Wellfield
Table 6-4	Simulated Effects on Spring Discharge – Northwestern Marion Wellfield
Table 6-5	Simulated Effects on Spring Discharge – Northeastern Marion Wellfield
Table 6-6	Projected Increase in Water Demand from 2010 to 2030: Potential Sumter Wellfield Participants
Table 6-7	Projected Increase in Water Demand from 2010 to 2030: Potential Citrus Wellfield Participants
Table 6-8	Projected Increase in Water Demand from 2010 to 2030: Potential Northwestern Marion Wellfield Participants
Table 6-9	Projected Increase in Water Demand from 2010 to 2030: Potential Northeastern Marion Wellfield Participants
Table 6-10	Conceptual Sumter Wellfield Transmission System
Table 6-11	Conceptual Citrus Wellfield Transmission System
Table 6-12	Conceptual Northwestern Marion Wellfield Transmission System
Table 6-13	Conceptual Northeastern Marion Wellfield Transmission System
Table 6-14	Sumter Wellfield: 10 mgd Capital Cost Estimate
Table 6-15	Citrus Wellfield: 7.5 mgd Capital Cost Estimate
Table 6-16	Northwestern Marion Wellfield: 15 mgd Capital Cost Estimate
Table 6-17	Northeastern Marion Wellfield: 15 mgd Capital Cost Estimate
Table 6-18	Sumter Wellfield: Operation and Maintenance Cost Estimate
Table 6-19	Citrus Wellfield: Operation and Maintenance Cost Estimate
Table 6-20	Northwestern Marion Wellfield: Operation and Maintenance Cost Estimate
Table 6-21	Northeastern Marion Wellfield: Operation and Maintenance Cost Estimate
Table 6-22	Sumter Wellfield: 10 mgd Unit Production Cost Estimate
Table 6-23	Citrus Wellfield: 7.5 mgd Unit Production Cost Estimate
Table 6-24	Northwestern Marion Wellfield: 15 mgd Unit Production Cost Estimate
Table 6-25	Northeastern Marion Wellfield: 15 mgd Unit Production Cost Estimate

Chapter 7

Table 7-1	Design Withdrawal from the Withlacoochee River at Trilby
Table 7-2	Conceptual Capital Cost Estimate
Table 7-3	Conceptual Operation and Maintenance Cost Estimate
Table 7-4	Conceptual Unit Production Cost Estimate

Chapter 8

Table 8-1	Design Withdrawal from the Withlacoochee River at Croom
Table 8-2	Proxy MFLs Flow Regimes at the Withlacoochee River near Holder Gage
Table 8-3	Potential Users for Surfacewater Supply
Table 8-4	WRWSA Potable Surfacewater Projects
Table 8-5	Conceptual North Sumter Finished Water Transmission System
Table 8-6	Conceptual Holder Finished Water Transmission System
Table 8-7	Conceptual Lake Rousseau Raw Water Transmission System
Table 8-8	Conceptual Lake Rousseau Finished Water Transmission System
Table 8-9	North Sumter Surfacewater: 10 mgd Capital Cost Estimate
Table 8-10	Holder Surfacewater: 25 mgd Capital Cost Estimate
Table 8-11	Lake Rousseau Surfacewater: 25 mgd Capital Cost Estimate
Table 8-12	North Sumter Surfacewater: 10 mgd Operation and Maintenance Estimate
Table 8-13	Holder Surfacewater: 25 mgd Operation and Maintenance Estimate
Table 8-14	Lake Rousseau Surfacewater: 25 mgd Operation and Maintenance Estimate
Table 8-15	North Sumter: 10 mgd Unit Production Cost Estimate
Table 8-16	Holder: 25 mgd Unit Production Cost Estimate
Table 8-17	Lake Rousseau: 25 mgd Unit Production Cost Estimate

Chapter 9

Table 9-1	Potential Users for Seawater Desalination Facility
Table 9-2	Conceptual Seawater Desalination Raw Water Transmission System

Table 9-3	Conceptual Seawater Desalination Finished Water Transmission System
Table 9-4	Seawater Desalination: 15 mgd Capital Cost Estimate
Table 9-5	Seawater Desalination: 15 mgd Operation and Maintenance Estimate
Table 9-6	Seawater Desalination: 15 mgd Unit Production Cost Estimate

Chapter 10

Table 10-1	WRWSA Water Supply Option Evaluation Criteria
Table 10-2	Water Supply Project Options WRWSA Comparison

Chapter 11

Table 11-1	Potential Demand and Reduction for SWFWMD Utilities with Per Capita Use >150 gpcpd
------------	--

Acronyms

\$/kgal	Dollars per thousand gallons
ACTIFLO	Ballasted Flocculation / Sedimentation System
ADF	Average Daily Flow
AGMOD	District's Agricultural Water Use Allocation Program
AWS	Alternative Water Supply
BCC	Board of County Commissioners
BEBR	Bureau of Economic & Business Research
BMF	Benchmark Farms Program
CFCA	Central Florida Coordination Area
cfs	cubic feet per second
COE	Corps of Engineers
Compendium	Marion County Compendium
Conservation Credits	"Water Conservation Credits"
Conservation Initiative	"WRWSA - Water Conservation Initiative"
Crom	Prestressed Concrete Tanks
DAF	Dissolved Air Flotation
DBP	Disinfection Byproduct
DIP	Ductile Iron Pipe
District	Water Management District
DSS	Domestic Self Supply
DWRM-2	District Wide Regional Model-2
ECF	East-Central Florida
ECFGWB	East-Central Florida Groundwater Basin
ECFT model	East-Central Florida Transient model
EQ tank	Equalization tank
EWUR	Estimated Water Use Report
FAAS	Fujian Academy of Agricultural Sciences
FAC	Florida Administrative Code
FAS	Floridan Aquifer System
FDACS	Florida Department of Agriculture and Consumer Services
FDEP	Florida Department of Environmental Protection
Forest	Withlacoochee State Forest
GHB	General Head Boundary
gpcpd	gallons per capita per day
gpm	gallons per minute
HCUD	Hernando County Utilities Department
HCW&SD	Hernando County Water and Sewer District

HMLL	High Minimum Lake Level
I/C	Industrial/Commercial
ICI	Industrial, Commercial and Institutional
ICU	Intermediate Confining Unit
IFAS	University of Florida Institute of Food and Agricultural Science
LFA	Lower Floridan Aquifer
MCC	Motor Control Center
MCU I	Middle Confining Unit I
MCU II	Middle Confining Unit II
M/D	Mining/Dewatering
MFLs	Minimum Flow and Levels
mgd	million gallons per day
MLL	Minimum Lake Level
Model	Conservation Model
MSCU/MCU	Middle Semi-Confining Unit/Middle Confining Unit
NCF	North-Central Florida
ND	Northern District
NDGM	Northern District Groundwater Model
NDWRAP	Northern District Water Resources Assessment Project
NGF	National Golf Foundation
NGVD	National Geodetic Vertical Datum
NOAA	National Oceanic and Atmospheric Administration
NRC	Nuclear Regulatory Commission
NWCFGWB	Northern West-Central Florida Groundwater Basin
NWI	National Wetlands Inventory
O&M	Operation and Maintenance
OFW	Outstanding Florida Water
Optimizer	"Water Conservation Optimizer"
PAC	Powdered Activated Carbon
PF	Peninsular Florida
PG	Thermoelectric Power Generation
Polk Model	Polk County Version of the Optimizer
Power Plant	Progress Energy Crystal River Power Plant
ppt	parts per thousand
PSA's	Public Service Announcement
PWRCA	Priority Water Resource Caution Area
R&R	Renewal and Replacement Costs
Reclaimed Plan	WRWSA Reclaimed Water Implementation Plan
Reclaimed Plan	WRWSA Reclaimed Water Implementation Plan
RIBs	Rapid Infiltration Basin

RO	Reverse Osmosis
ROMP	Regional Observation and Monitoring Program
RWSA	Regional Water Supply Authority
SA	Surficial Aquifer
SCEEC	Springs Coast Environmental Education Center
SJRWMD	St. Johns River Water Management District
SRWMD	Suwannee River Water Management District
SWFWMD	Southwest Florida Water Management District
SWFWMD Model	"SWFWMD Non-Agricultural Water Conservation Modeling"
SWPCG	Subcommittee of the Water Planning Coordination Group
SWTP	Surfacewater Treatment plant
SWUCA	Southern Water Use Caution Area
TBW	Tampa Bay Water
TOC	Total Organic Compounds
UFA	Upper Floridan Aquifer
ULV	Ultra Low Volume
USDA-SCS	U.S. Department of Agriculture-Soil Conservation Service
USGS	United States Geological Survey
W.A.T.E.R.	Water Awareness Through Education and Research
WCS	Water Conservation Structure
WMIS	Water Management Information System
WRWSA	Withlacoochee Regional Water Supply Authority
WRWSA - MWSP&IP	WRWSA Master Water Supply Planning and Implementation Program
WRWSA RWSPU	Withlacoochee Regional Water Supply Authority - Regional Water Supply Plan Update - 2005
WTP	Water Treatment Plant
WUPs	Water Use Permits
WWTFs	Wastewater Treatment Facilities
WWTP	Wastewater Treatment Plant

Executive Summary

A. Introduction

In 2005 the Withlacoochee Regional Water Supply Authority (WRWSA) established the WRWSA – Master Water Supply Planning and Implementation Program (WRWSA – MWSP&IP) which is a comprehensive process to plan for the region’s water supply future. The WRWSA – MWSP&IP is a multi-year, multi-phase program that was follow-on to the WRWSA Regional Water Supply Plan Update (RWSPU). It contains phases for water supply planning, Identification and prioritization of water supply projects, the design of selected projects and implementation the projects and initiatives.

This report, the WRWSA – Detailed Water Supply Feasibility, was initiated in 2007 to follow-on to the WRWSA RWSPU and is considered Phase II of the WRWSA – MWSP&IP process. Its purpose is to update regional population and water demands and determine potential water supply projects to supply these needs. As the study progressed Marion County decided to rejoin the WRWSA. The inclusion of Marion County into the WRWSA added challenges and opportunities with respect to regionally sustainable water supply development. Geographically, the WRWSA has increased by approximately 86% from 1,892 square miles to 3,516 square miles. The existing population of the WRWSA has increased by approximately 68% from 494,931 to 732,681 (2005 estimate). It was decided to suspend work on the WRWSA – Detailed Water Supply Feasibility until Marion County was integrated into the planning process..

The inclusion of Marion County to the WRWSA required that the RWSPU be appended to consider existing and projected water demands in Marion County, and that the appended RWSPU outline the basis for future water supply development in the WRWSA region including Marion County. This was completed in December of 2009 with the publication of the RWSPU - Marion County Compendium.

B. WRWSA Detailed Water Supply Feasibility Study

As stated the WRWSA Detailed Water Supply Feasibility purpose is to update regional population and water demands and determine potential water supply projects to supply these needs. The projects are conceptualized, evaluated, ranked and prioritized according to short-term (0-20 years), medium-term (15-35 years), and long-term (30-50 years) planning horizons within this report.

C. Population and Water Demands within the WRWSA

Existing water demand and projections of future demand within the WRWSA were generated using 2005 as a base year. Water demand projections were evaluated based on a planning horizon of twenty (20) years from 2010-2030. The projections provide critical input to capital improvement plans and long-range water supply policy.

The vast majority of the current water demand within the WRWSA is from water withdrawn from groundwater sources. Public supply; domestic self-supply; industrial/commercial; mining/dewatering; power generation; agricultural; and recreational/aesthetic water use demands are considered in the report because these uses provide a comprehensive picture of

the total current and future water demands in the region. All water use categories are projected to increase over the planning horizon.

Public supply demands dominate, and will continue to be the largest water use within the WRWSA representing 70% of the increase. The total WRWSA public supply water demand was approximately 81.40 million gallons per day (mgd) in 2005 and is expected to increase to 147.77 mgd in 2030. The domestic self-supply water demand for the WRWSA was approximately 30.22 mgd in 2005, and expected to be 47.85 mgd in 2030. The total WRWSA industrial/commercial, mining/dewatering and power generation water demand was approximately 26.03 mgd in 2005, and estimated to decrease to 21.10 mgd in 2030. The total WRWSA recreational water demand was approximately 20.59 mgd in 2005, and anticipated to increase to 33.76 mgd in 2030. The total WRWSA agricultural water demand was approximately 16.12 mgd in 2005, and is expected to be about 18.59 mgd in 2030. The total WRWSA current demand is approximately 174.36 mgd. This total water demand is expected to increase to approximately 269.07 mgd in 2030. This demand equates to an approximate increase of 94.71 mgd (54%) in 2030.¹

D. Water Resource Minimum Flows and Levels (MFLs)

MFLs for priority water bodies are required by Florida Statutes to be established by Florida's Water Management Districts to protect water resources and ecology from significant harm due to water withdrawals. Established MFLs can be constraints to water supply development. MFL priority water bodies are identified and scheduled based on the importance of the water resource and the existence of or potential for significant harm to the water resources or ecology of region. MFL priority lists are updated by the Districts annually.

The Southwest Florida Water Management District (SWFWMD) and the St. Johns River Water Management District (SJRWMD) have adopted 23 MFLs located in the WRWSA region. MFLs have been established for 21 lakes, one (1) wetland and one (1) spring. MFLs have been established in every county within the WRWSA.

The SWFWMD and SJRWMD have scheduled 14 MFLs located in the WRWSA for establishment. MFLs are scheduled for five (5) lakes, two (2) rivers, and seven (7) springs. These MFLs are also located throughout the WRWSA.

MFLs are scheduled, but have not been adopted for the Withlacoochee or Ocklawaha River systems and most of the springs within the WRWSA. These MFLs may have a significant impact on future groundwater and/or surface water development within the region.

As part of this report, the WRWSA has developed proxy thresholds on water systems that are yet to be completed. These proxy thresholds will ensure that proposed water supply projects recognize potential MFL withdrawal constraints. Proxy MFLs are developed for the Withlacoochee River and springs in Citrus, Sumter, and Hernando Counties

¹ Actual water demand in the future will vary based on a variety of factors, including the actual rate of population growth.

E. Regional Groundwater Assessment

The groundwater resource assessment completed in this report is a planning-level evaluation that identifies areas in the WRWSA where groundwater will be generally available or where further investigation into aquifer supplies is needed. The evaluation uses regional groundwater flow modeling to simulate declines in aquifer levels due to projected groundwater withdrawals in 2030, based on current population growth projections. The evaluation determined that existing permitted allocations, available local groundwater resources, conservation and reclaimed water will be generally sufficient to serve the projected 2030 groundwater demand in the WRWSA. However, localized resource constraints have the potential to materialize in certain areas prior to 2030.

The SWFWMD Northern District (ND) groundwater flow model is utilized for the groundwater assessment in the SWFWMD jurisdiction in Marion, Citrus, Sumter, and Hernando Counties. The SJRWMD North-Central Florida (NCF) groundwater flow model is utilized for the SJRWMD jurisdiction of Marion County. The projected groundwater withdrawals used for the 2030 evaluation assume continued reliance on groundwater extracted from existing withdrawal locations at current levels of water conservation, using current population growth projections for 2030. The assessment does not simulate increases in supplies of beneficial reuse, alternative water supply development, or reductions in future water demand (conservation or diminished growth). Simulated declines in aquifer levels are evaluated to determine the potential to affect lakes and wetlands, spring flows, and MFL priority water bodies due to increased groundwater withdrawals. Water resource criteria are used to identify potential adverse impacts to groundwater resources due to the simulated declines in aquifer levels. SWFWMD and SJRWMD resource assessment methodologies are used in the respective jurisdictions to determine potential adverse impacts to groundwater resources due to model simulated declines in aquifer levels. The presence (or absence) of potential adverse impacts is used to interpret the viability of fresh groundwater to serve future water demands to 2030.

Based on ND Model results within its domain and SWFWMD resource assessment methodologies, groundwater appears to be viable to serve projected water demand in 2030 in Citrus County and the SWFWMD jurisdiction in Marion County.

Based on NCF model results within its domain and SJRWMD resource assessment methodologies, groundwater does not appear to be viable to serve all projected water demand in 2030 in the SJRWMD jurisdiction in Marion County.

The potential effects of projected 2030 groundwater withdrawals in northern Sumter County and southern Marion County are difficult to interpret, but suggest a need for additional supplies or reductions in demand from conservation. Additional hydrogeologic data collection, monitoring, and analysis are warranted in this area.

In Hernando County, projected water demand in 2030 could lead to restrictions on groundwater withdrawals in the Spring Hill area, potentially requiring additional supplies or demand reduction from conservation. Dispersed groundwater withdrawals in Hernando County located to the north or east of the Weekiwachee springshed appear to be viable.

The SWFWMD and SJRWMD are developing an accelerated data collection and monitoring program in southern Marion, northwest Lake, and northern Sumter County over the next two

years (SWFWMD, 2008). Information gained from this program will provide important data for refinement of the groundwater flow models used in this assessment. The information used for this groundwater resource assessment will be updated by the SWFWMD and SJRWMD at minimum 5 year intervals.

F. Water Conservation

This report considers water conservation as an essential, cost-effective water supply management tool, with many potential means of implementation, ranging from the utilization of Florida Friendly Landscaping techniques to conservation rate structures. A variety of ad-hoc conservation efforts are currently in place among WRWSA members. Water conservation is considered first of the potential water planning and water supply options to handle future water demands in the region.

SWFWMD is in the process of implementing, and the SJRWMD is considering mandatory per capita requirements for the water users in their respective districts. SWFWMD has proposed rules to standardize and enhance water conservation and water use permitting requirements district-wide. Enhanced requirements include: compliance per capita rates, conservation rate structures, water billing requirements, water audits, wholesale permits and annual reports for public supply utilities. The WRWSA has directly funded water conservation programs in Hernando, Citrus, Marion and Sumter Counties.

This report includes an updated inventory of conservation measures, but also discusses and includes recent modeling completed by the SWFWMD that quantifies the potential savings and benefits of new water conservation devices. Optimized SWFWMD Model results indicate that significant conservation savings can be achieved in each county of the WRWSA. Water conservation efforts are categorized in three categories, as was done in the RWSP: Regulation, Education and Incentives. The report concludes that additional water conservation measures must be implemented to reduce the future water demands projected for the WRWSA.

G. Reclaimed Water

Reclaimed water systems are an important piece of a water supply strategy reducing the dependence on potable supplies for irrigation and industrial use and lowering per capita rates throughout the WRWSA. Some utilities in the WRWSA region now have special conditions in their water use permits that focus on reclaimed water and lower quality source expansions of their current water supply systems. Based on this many WRWSA member governments now recognize the benefits of reuse systems and are in the process of wastewater treatment plant (WWTP) upgrades to public supply standards and/or increasing the size of existing beneficial reuse facilities. Reclaimed water systems in the WRWSA are mostly in the early stages of development, except for a few larger population centers.

For water supply purposes, beneficial reuse is defined as that which replaces traditional groundwater or surfacewater uses. Fourteen domestic WWTPs in the WRWSA currently provide beneficial reuse or have funded expansions to do so. This is an increase of three WWTPs from the analysis completed as part of Phase I – WRWSA – Regional Water Supply Plan Update. Twenty-four domestic WWTPs in the WRWSA currently provide beneficial reuse or have identified projects and customers that will add or expand their reuse supply for beneficial use.

The reclaimed water chapter of this report identifies three additional reuse projects and prepares cost estimates for each project. Unit production costs range from \$ 0.85 to \$ 2.17 per 1,000 gallons; a large percentage of the cost is due to transmission to potential end users. Users identified for the three projects were golf courses due to their proximity, estimated potential groundwater offset and high efficiency of use. The cost and complexity of offsetting potable use with reuse water remains higher than that of traditional groundwater. Site-specific combinations of regulatory requirements and other factors will drive the implementation of specific reuse projects. The relationship of groundwater availability to beneficial reuse implementation suggests that regional coordination could benefit reclaimed water planning in the WRWSA.

H. Water Supply Project Ranking

This analysis evaluates and ranks potential regional water supply project options and conservation within the WRWSA. The intent of this analysis is to provide a menu of alternatives to the WRWSA and its members as they plan to meet future water demands within their jurisdictions. The potable water source projects were graded relative to their general feasibility for supply development, using a qualitative evaluation matrix.

These projects include: Northeast Sumter Regional Wellfield; Southern Citrus Regional Wellfield; Northwestern Marion Regional Wellfield; Eastern Marion Regional Wellfield; Lake Rousseau; Withlacoochee River near Holder – Reservoir; North Sumter “Conjunctive Use” Supply; Withlacoochee River Aquifer Recharge near Trilby; and Crystal River Power Plant Desalination. For comparison with projects involving water supply development, water conservation was also evaluated as a potential project, utilizing the results of the SWFWMD Model. The evaluation provides input to the WRWSA’s prioritization process where the potential groundwater and AWS projects will be compared to the expected needs of member governments.

The water supply evaluation criteria include seven (7) categories which contain some of the key elements important to determining the viability of proposed water supply projects. The evaluation criteria include: Environmental Impacts; Ability to Permit; Public Perception; Long-Term Viability of Source; Costs; Ability to Serve Multiple Users; and Estimated Time to Implement.

Water conservation is the highest graded alternative of those considered for the project ranking. The option receives high grades in six of the seven evaluation categories. According to the SWFWMD Model results, the optimized cost of water conservation in each county of the WRWSA is below benchmark costs for dispersed groundwater and potable AWS development.

I. Water Supply Project Options

1. Potable Traditional Water Supply Development

Many utilities in the WRWSA region now have special conditions in their water use permits that require additional conservation measures and the development of alternative or non-local water supplies if unacceptable adverse impacts to natural resources are observed.

The dispersal of groundwater supplies helps to minimize adverse impacts from withdrawals, because aquifer declines resulting from withdrawals are dispersed rather than concentrated. Dispersed wellfields provide an option for member utilities facing local groundwater resource limitations to continue to rely on fresh groundwater for supply. Dispersed wellfield projects will need to comply with all water use permitting criteria, including requirement for participating members to utilize feasible lower quality sources and reduce demand through conservation.

Within the WRWSA – Detailed Water Supply Feasibility Analyses the following projects have been the focus of the analyses of the WRWSA region: **Fresh Groundwater:** Sumter Wellfield; Citrus Wellfield; Northwestern Marion Wellfield; and the Northeastern Marion Wellfield. Conceptual water production cost estimates for the groundwater projects range from \$ 0.63 per thousand gallons to \$ 0.81 per thousand gallons. Each of these projects reflects the cost-competitiveness of utilizing dispersed groundwater versus potable alternative water supplies.

Based on the water supply project ranking, the Sumter and Northwestern Marion Wellfields are recommended for possible implementation in the Short-Term (0-20 years). The Citrus and Northeastern Marion Wellfields are recommended for possible implementation in the Mid-Term or Long-Term (15-35 or 30-50 years).

Each project could serve to transmit future conjunctive or alternative water supplies through a project hub. Transmission pipelines for the groundwater projects could be part of an incremental approach towards potable alternative water supply. Additional study should occur to identify potential sites and easement routes for acquisition. Each of the project options will require more detailed analysis to fine tune the design elements in accordance with water use permitting criteria and the needs of utilities that choose to participate. A dispersed wellfield typically requires 3 to 5 years to implement.

2. Potable Alternative Water Supply Planning

Within the WRWSA – Detailed Water Supply Feasibility Analyses the following projects have been the focus of the long range AWS analyses of the WRWSA region: **Surface Water:** Lake Rousseau; Withlacoochee River near Holder – Reservoir; and the North Sumter “Conjunctive Use” Supply. **Aquifer Recharge:** the Withlacoochee River Aquifer Recharge near Trilby, and **Seawater:** Crystal River Power Plant Seawater Desalination. Each of these projects reflects the higher costs of utilizing potable alternative water supplies versus traditional groundwater supplies.

The conceptual water production costs for the Withlacoochee River project options range from \$2.38 to \$3.15 per thousand gallons. The conceptual water production cost for the seawater desalination project is \$4.27 per thousand gallons. For the aquifer recharge option, depending on the amount of recharge, the unit production cost of the project may range from \$0.76 to \$6.85 per thousand gallons of recharge. Transmission costs range from about 25% to 50% of the water production costs for the Withlacoochee River options. Operating and transmission costs account for over 75% of the water production cost for the seawater desalination option.

Existing permitted allocations, available local groundwater resources, conservation and reclaimed water will be generally sufficient to serve the projected 2030 groundwater demand in the WRWSA. Therefore, none of the potable AWS projects are recommended for possible implementation in the Short-Term (0-20 years), and further updates will be needed to refine these complex and challenging projects as growth occurs over time.

Based on the water supply project ranking, the **Surface Water:** Lake Rousseau and North Sumter “Conjunctive Use” Supply projects are recommended for possible implementation in the Mid-Term or Long-Term (15-35 or 30-50 years). The **Seawater:** Crystal River Power Plant Seawater Desalination is recommended for possible implementation in the Mid-Term or Long-Term (15-35 or 30-50 years). The **Surface Water:** Withlacoochee River near Holder – Reservoir project is not recommended for possible implementation due to the high cost of the reservoir. The **Aquifer Recharge:** the Withlacoochee River Aquifer Recharge near Trilby project is not recommended for WRWSA implementation, but may be pursued by other entities.

Additional study is underway by the SJRWMD on the Lower Ocklawaha River and desalination from the east coast of Florida (Coquina Coast Desalination Plant). These projects could potentially provide alternative water supply to WRWSA members, but are not evaluated by the WRWSA.

Flexible strategies are needed to ensure that suitable supplies are available when groundwater is depleted and AWS is required to meet future water demands in the WRWSA region. Long-range planning for surface water development should consider dispersed groundwater development in the vicinity of the river systems. Dispersed groundwater projects could transmit future river supplies through their transmission systems.

J. Proposed Regional Framework for Future Water Supply

Water supply planning within the WRWSA is based on the knowledge that regionalization of water sources and alternative water supplies will be necessary at some point in the future. The challenge for the Authority is how to facilitate their introduction into the region. The economic slowdown has reduced the projected water demand in the region giving the WRWSA and its members an opportunity to comprehensively plan for the long-term water needs. A regional framework for a long-term water supply strategy that will manage the technical, economic, environmental and political issues associated with timely development of long-term, sustainable water supplies has been proposed by the WRWSA.

The regional framework is based on a number of critical assumptions including:

- Fresh groundwater is the preferred water source in the WRWSA;
- Water supply development should be based on short-, mid-, and long-term planning terms;
- Both centralized and decentralized water systems are appropriate within the WRWSA;
- Location of these systems are critical for future interconnections and the introduction of AWS; and

- Interconnected water systems have multiple benefits including the eventual introduction of AWS.

The regional framework contemplates that within the short-term timeframe, water conservation, reclaimed water projects and developing groundwater will provide the needed water to meet demands. Mid-term projects will include the interconnections of strategic water supplies throughout the WRWSA region. Long-term water supply projects will be the introduction of AWS into the interconnected regional system. The WRWSA has conceptually approved the regional framework concept and will continue working on its implementation.

K. Recommendations

A series of recommendations have been developed based on the WRWSA – Detailed Water Feasibility Analysis. These recommendations are an attempt to develop and raise a series of suggestions and options for consideration by the WRWSA. These recommendations are not necessarily prioritized or set in a sequential order but are important to consider as the WRWSA moves forward in these relatively uncertain times with respect to sustainable water supply for its members. The recommendations set the stage for considerable discussion and deliberation with the WRWSA Board as they consider the existing and future role of the Authority and how it will encompass its members.

The recommendations are organized by the following categories:

- Population and Water Demand;
- Hydrogeologic Data Collection and Resource Monitoring;
- Regional Groundwater Assessment;
- Water Conservation;
- Reclaimed Water;
- Water Supply Project Options;
- Water Supply Partnership Options;
- WRWSA - Water Supply Regional Framework;
- SWFWMD/SJRWMD Coordination and Consistency; and
- Coordination with Water Management District Program Initiative.